

GENERAL DESCRIPTION

The DAT 3024 device generates up to 4 output analog signals from digital commands. Data values are transmitted with MODBUS RTU/ASCII protocol on the RS-485 network (RS-232 interface is available).

It is possible to generate voltage signals up to 10V and current signals up to 20mA, both active or passive loops.

By means of a 16 bit converter, the device guarantee a high accuracy and a stable measure versus time and temperature.

To ensure the plant safety, two Watch-Dog timer alarms are provided.

The 2000 Vac isolation between input, power supply and serial line removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

DAT 3024 is in compliance with the Directive 2004/108/EC on the electromagnetic compatibility.

The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The DAT3024 is designed to work with the <u>MODBUS RTU/ASCII protocol</u>: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, see the relative User Guide.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, it can be hardly to establish a communication with them; connecting the INIT terminal to the GND terminal (ground), at the next power-up the device will be self-configured in the default settings (see Operating User Guide).

Connect power supply, serial bus and analog outputs as shown in the "Wiring" section.

The "PWR" LED state depending to the working condition of the device: see the "Light Signaling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the Operating User Guide.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

Output type	Min	Мах	Auxiliary Voltage	12V @ 20mA (4 channels)	Power Supply	
Voltage ∨ Current	0 V	+10 V	Rise time Analog output Slew	<i>ı</i> -rate	Supply Voltage Current consumption Polarity inversion protection	18 30 Vdc 30 mA @ 24 Vdc 100 mA max 60 Vdc max
mA	0 mA	+20 mA	(independent progr	ammation for each channel)	Isolation Input – RS485	2000 Vac 50 Hz, 1 min.
Output calibration			V/s	mA/s	Supply – Input Supply – RS485	2000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min.
Voltage ±10 mV Current ±20 μA Load resistance Voltage > 5 KΩ Current < 500 Ω		0.125 0.250 0.500 1.000 2.000 4.000 Immediate	0.250 0.500 1.000 2.000 4.000 8.000 Immediate	Temperature & Humidity Operating temperature Storage temperature Humidity (non condensing)	-10°C +60°C -40°C +85°C 0 90 %	
Thermal drift Full scale 100 ppm max		Data Transmission Baud Rate Max distance	115.2 Kbps 1.2 Km	Housing Material Mounting Weight EMC (for industrial enviro Immunity Emission	Self-extinguishing plastic EN-50022 DIN rail ~ 150 g. nments) EN 61000-6-2 EN 61000-6-4	

INSTALLATION INSTRUCTIONS

The DAT 3024 device is suitable for fitting to DIN rails in the vertical position.

For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and at least one of the overload conditions exist.

 If panel temperature exceeds 35°C and at least two of the overload conditions exists.

The overload conditions are the following:

- High supply voltage: >27Vdc


- Use of the auxiliary power supply

Make sure that sufficient air flow is provided for the device avoiding to place racewais or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.



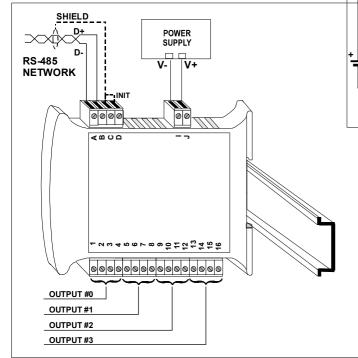

LIGHT SIGNALING


LED	COLOUR STATE		DESCRIPTION	
PWR	GREEN	ON	Device powered	
		OFF	Device not powered / Wrong RS-485 cabling.	
		FAST BLINK	Communication in progress (blink frequency depends to baud-rate)	
		1 second BLINK	Watch-Dog Alarm condition	

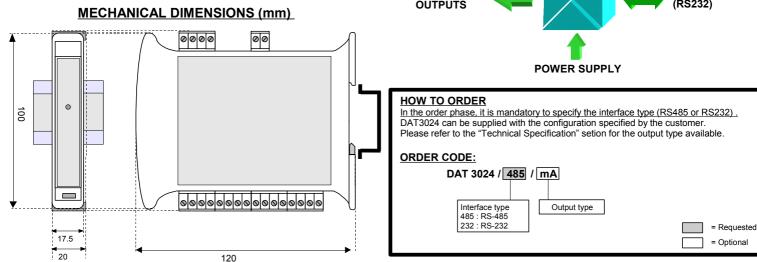

Datexel s.r.l. reserves its right to modify the characteristics of its products totally or in part without notice at any time.

ED.05.06 REV.07

-

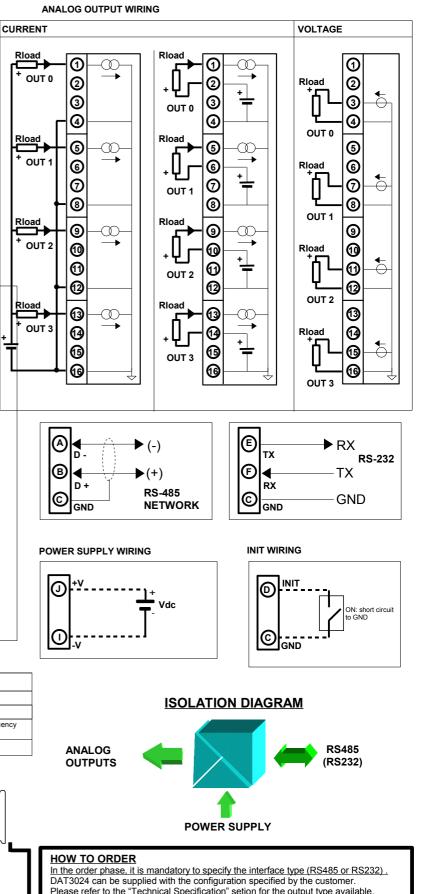

WIRING